



NON-PAVED AREAS

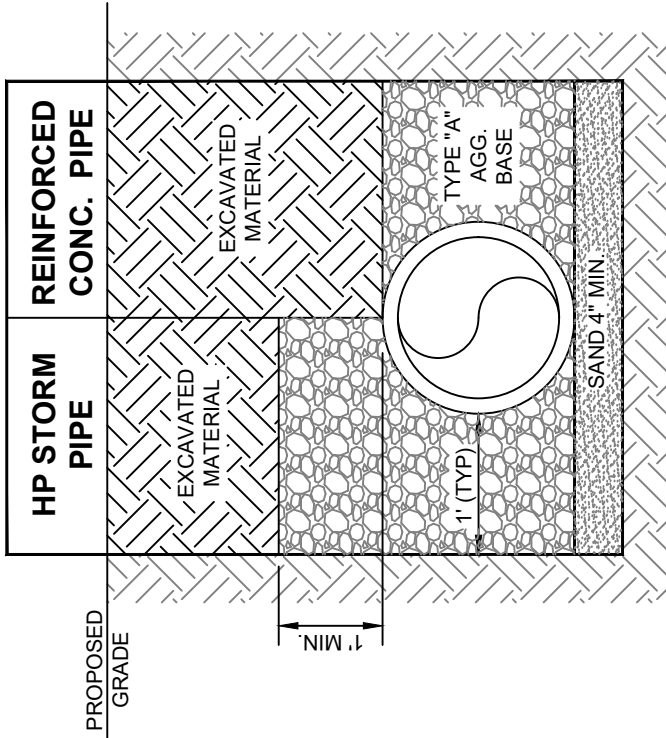

PAVED AREAS

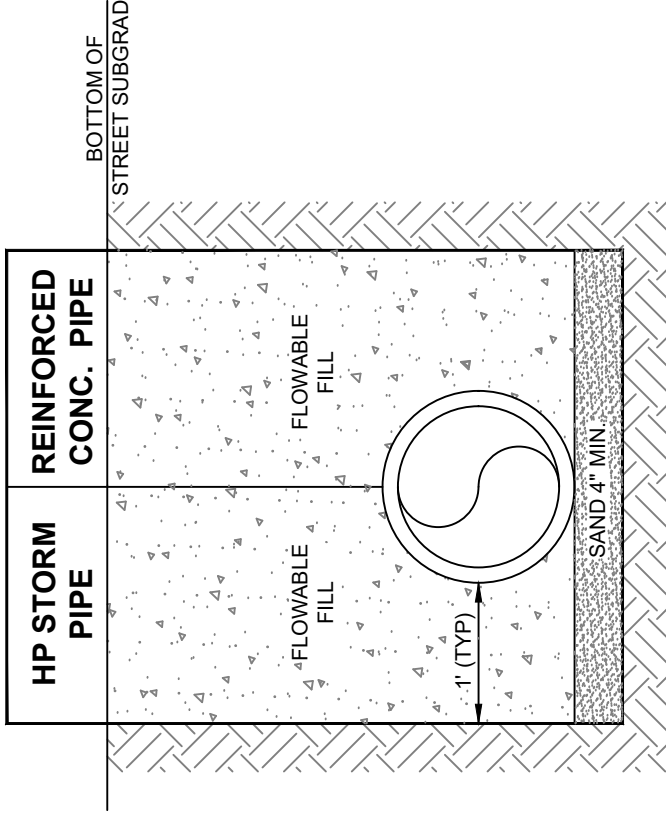

STORMWATER PIPE BEDDING

- NOTES:
1. CRUSHED ROCK SHALL BE ODOT TYPE "A" AGGREGATE BASE.
 2. NON-PAVED AREAS SHALL BE COMPACTED TO 90% MAX. STANDARD PROCTOR DENSITY FOR COHESIONLESS SOILS AND 85% FOR COHESIVE SOILS.
 3. FLOWABLE FILL SHALL BE USED IN PAVED AREAS FROM BEDDING TO BOTTOM OF PAVEMENT.
 4. SEE SAN-01 FOR SEWER PIPE MATERIAL REQUIREMENTS.

REVISION	BY	DATE

STORMWATER PIPE INSTALLATION	
STANDARD DETAILS	
CITY OF JENKS, OKLAHOMA	
ENGINEERING DEPARTMENT	
DATE: 4-11-22	STANDARD NO: STRM-01