



PVC LINE	CASING DIA.	RCP C-303	CASING DIA.	RCP C-301	CASING DIA.	DIP LINE	CASING DIA.
1"	4"	12"	20"	16"	20"	8"	20"
1 1/2"	6"	16"	30"	20"	30"	10"	24"
2 1/2"	6"	20"	30"	24"	36"	12"	30"
3"	6"	24"	36"	30"	42"	16"	36"
4"	10"	30"	42"	36"	48"	20"	42"
6"	12"	36"	48"	42"	54"	24"	48"
8"	16"	42"	60"	48"	60"	30"	54"
10"	18"	48"	66"	54"	66"	36"	60"
12"	20"	54"	66"	54"	72"	42"	66"

NOTES:

1. REFER TO PLAN & PROFILE FOR CASING LENGTH & WALL THICKNESS .
2. SPACERS SHALL BE POLYETHYLENE MEETING ASTM REQUIREMENTS.
3. EACH END OF CASING SHALL BE SEALED WITH A WATER-TIGHT, REMOVABLE SEAL.
4. 3 SPACERS ARE REQUIRED FOR INDIVIDUAL CARRIER PIPE SECTIONS OF 12', OR LESS, IN LENGTH.
5. ALL CARRIER PIPE SHALL HAVE MECHANICALLY RESTRAINED JOINTS THROUGH CASING.

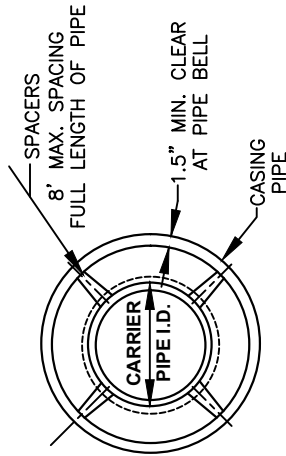

SECTION A-A

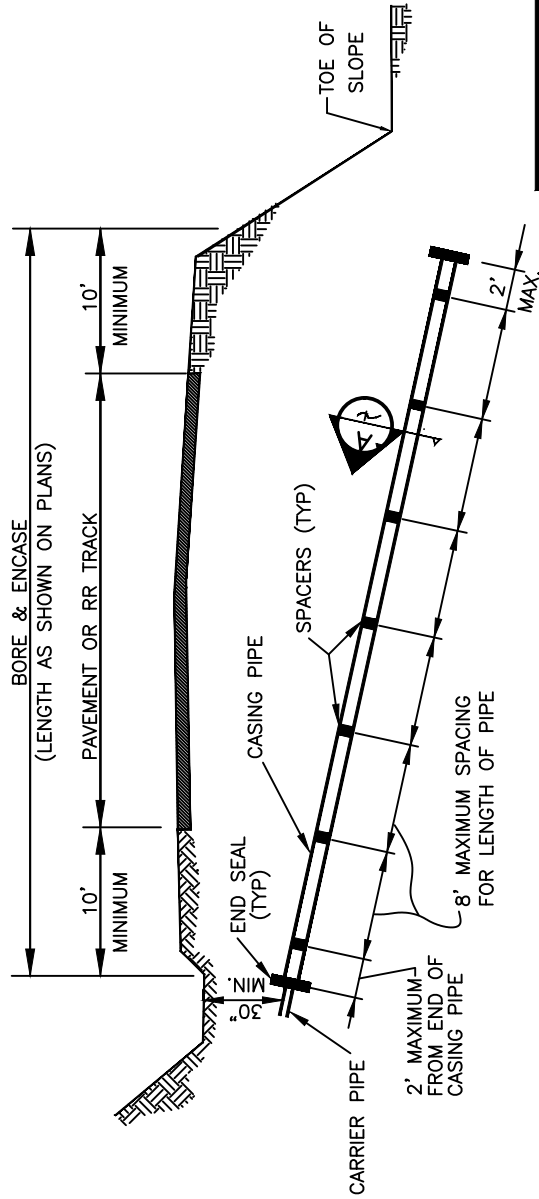

PIPE BORE DETAIL	
REVISION	DATE
BY	DATE
STANDARD DETAILS	
CITY OF JENKS, OKLAHOMA	
ENGINEERING DEPARTMENT	
DATE:	STANDARD NO.
4-11-22	MISC-03